

Riverbank Acoustical Laboratories (RAL)TM / An Alion Science Technical Center (RALVer 11.0)
 Sound Absorption and Sound Absorption Coefficients
 by the Reverberation Room Method ASTM C 423-09a/E 795-08/NVLAP 08/P03

TEST NUMBER: A14-044 - C TEST DATE: FEBRUARY 25, 2014

CLIENT: GIK Acoustics
 DESIGNATION: FreeStand Acoustic Panel (on 5" Spacers)
 DIMENSIONS: 120" x 84" x 2.125"
 AREA: 70.0 ft²
 WEIGHT: 63.25 lbs AREA WEIGHT: 0.90 lbs/ft²
 MOUNTING: F EDGE SEAL: Unsealed
 SPECIMEN DETAILS: F-130 Mounting Using 5" Spacers - 6@ 60"x24"x2.125" and 2@60"x12"x1.125"

TEST ROOM DETAILS: Room 0 Volume = 10311 ft³ Area = 2864.3 ft²
 FILE NAME: A14_044_140225_C.doc


1/3 OCTAVE CENTER FREQ. (Hz)	ABSORPTION COEFFICIENT	TOTAL ABSORPTION (SABINS)
40	0.12	8.24
50	0.03	1.88
63	-0.10	-7.20
80	0.09	6.42
100	0.35	24.17
125	0.52	36.29
160	0.55	38.16
200	0.73	51.21
250	0.91	63.59
315	1.15	80.51
400	1.30	90.99
500	1.39	97.65
630	1.41	98.41
800	1.31	91.52
1000	1.24	86.63
1250	1.25	87.79
1600	1.28	89.75
2000	1.21	84.52
2500	1.22	85.75
3150	1.18	82.90
4000	1.24	86.58
5000	1.29	89.97
6300	1.24	87.08
8000	1.24	86.47
10000	1.10	76.96

SOUND ABSORPTION AVERAGE [SAA] = 1.20
NOISE REDUCTION COEFFICIENT [NRC] = 1.20

Test Conducted by: Marc Sciaky

This single report page and accompanying graph contain the instantaneous raw data as provided to the client after testing of the specimen. This data, although accurate, is incomplete without the full specimen description, mounting details and signature pages. The full report referenced by the RAL test number above should be consulted for further information regarding these results.

SOUND ABSORPTION REPORT
RAL - A14-044 - C

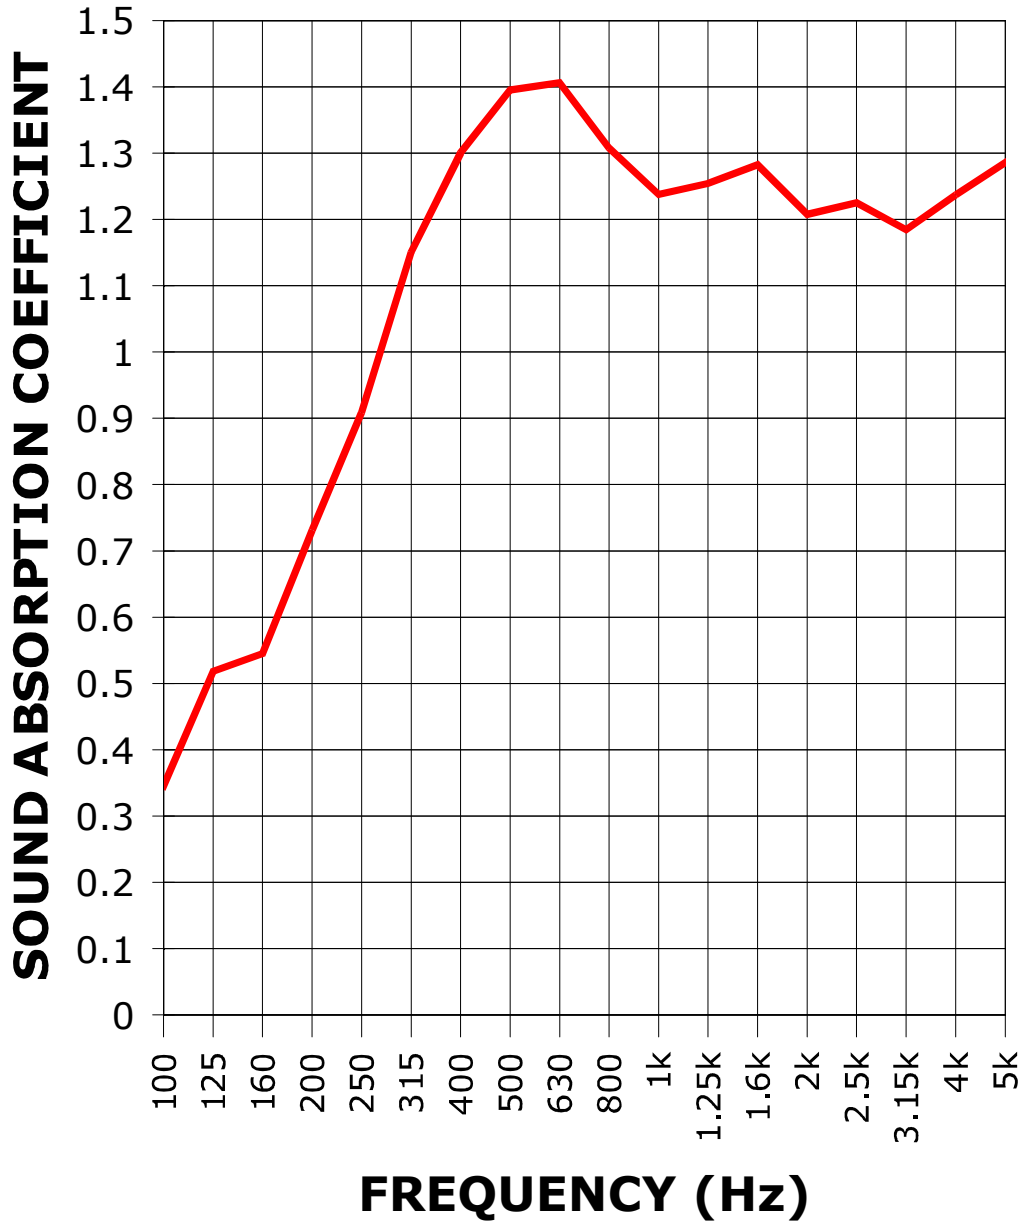

SAA = 1.20
NRC = 1.20